



K42N trafo 2 Fd D -- Trafo 1 Feder E

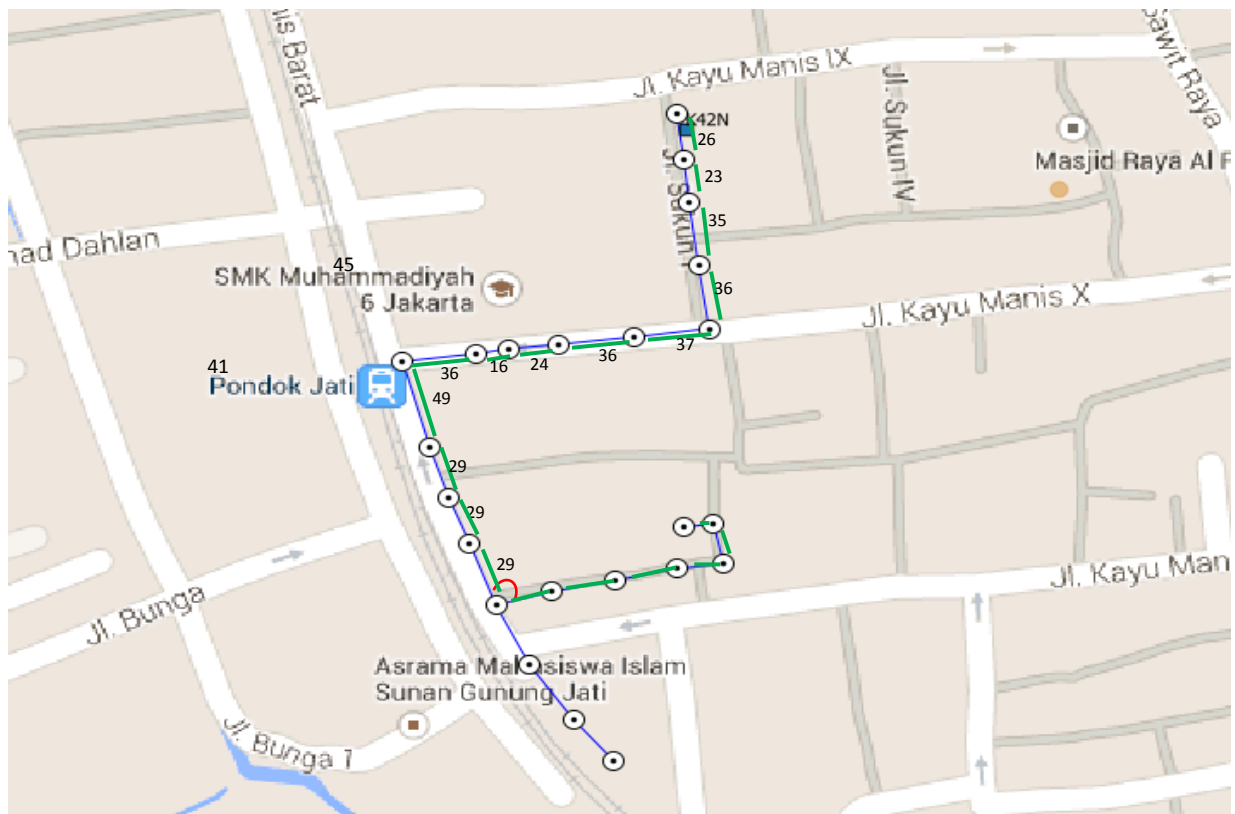

Kabel 3x70+50 mm² = **437** mtr, Kabel NFGBY 4x95 mm² = **12** mtr, Joint Out door 70-95 mm² = **1** set,
 Pipa galvanis 2,5' = **3** mt, Schoon 95 mm² = **4** bh, Joint sleve 70mm² = **3** bh, Joint sleve 50 mm² = **1** bh,
 CCO 70mm² = **1** bh, Suspension = **10** bh, Dead end = **6** bh, Steelestel = **21** mt, Stopping Buckle = **37** bh
 Bundell Protecscion = **0** bh, Earting Rod BC = **1** bt, Pipa galvanis 3/4' = **3** mt, Groudflat = **3** BH,
 NH Fuse 250 A = **3** bh, Tiang besi 9/200 = **0** bh

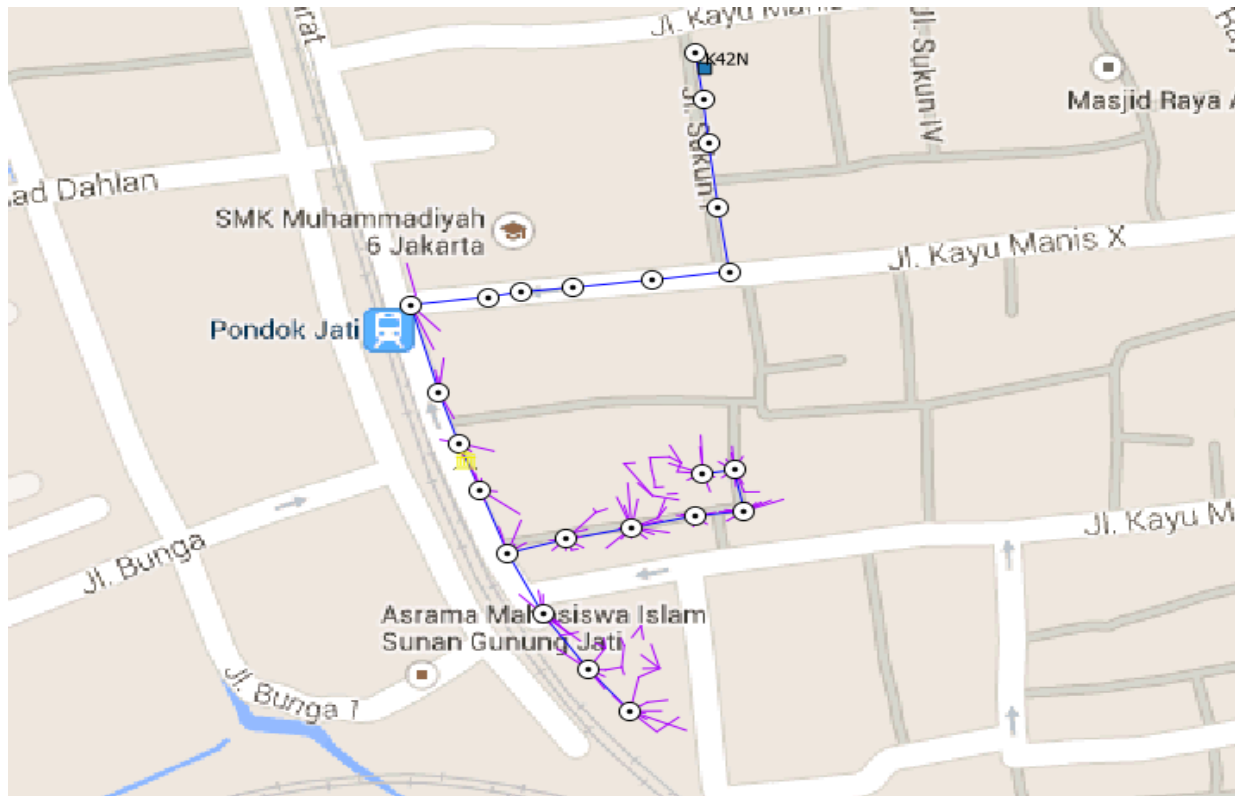