



— Penghantar TM Ø 150 mm²


— Penghantar TM Ø 70 mm²

— FCO Jaringan

— LBSM — LBS Manual

— REC — Recloser

10		Bh	Trafo Portal 250 kVA
9		Bh	Trafo Portal 100 kVA
8		Bh	Trafo Portal 50 kVA
7		Bh	Trafo Portal 25 kVA
6		Bh	Trafo Cantol 16 kVA
5		Meter Sirkuit	AAAC 3 x 35 mm ²
4		Meter Sirkuit	AAAC 3 x 70 mm ²
3		Meter Sirkuit	AAAC 3 x 150 mm ²
2		Meter Sirkuit	MVTIC 3 x 150 mm ²
1		Meter Sirkuit	SKTMAL 3 x 240 mm ²
NO	JUMLAH	SATUAN	URAIAN

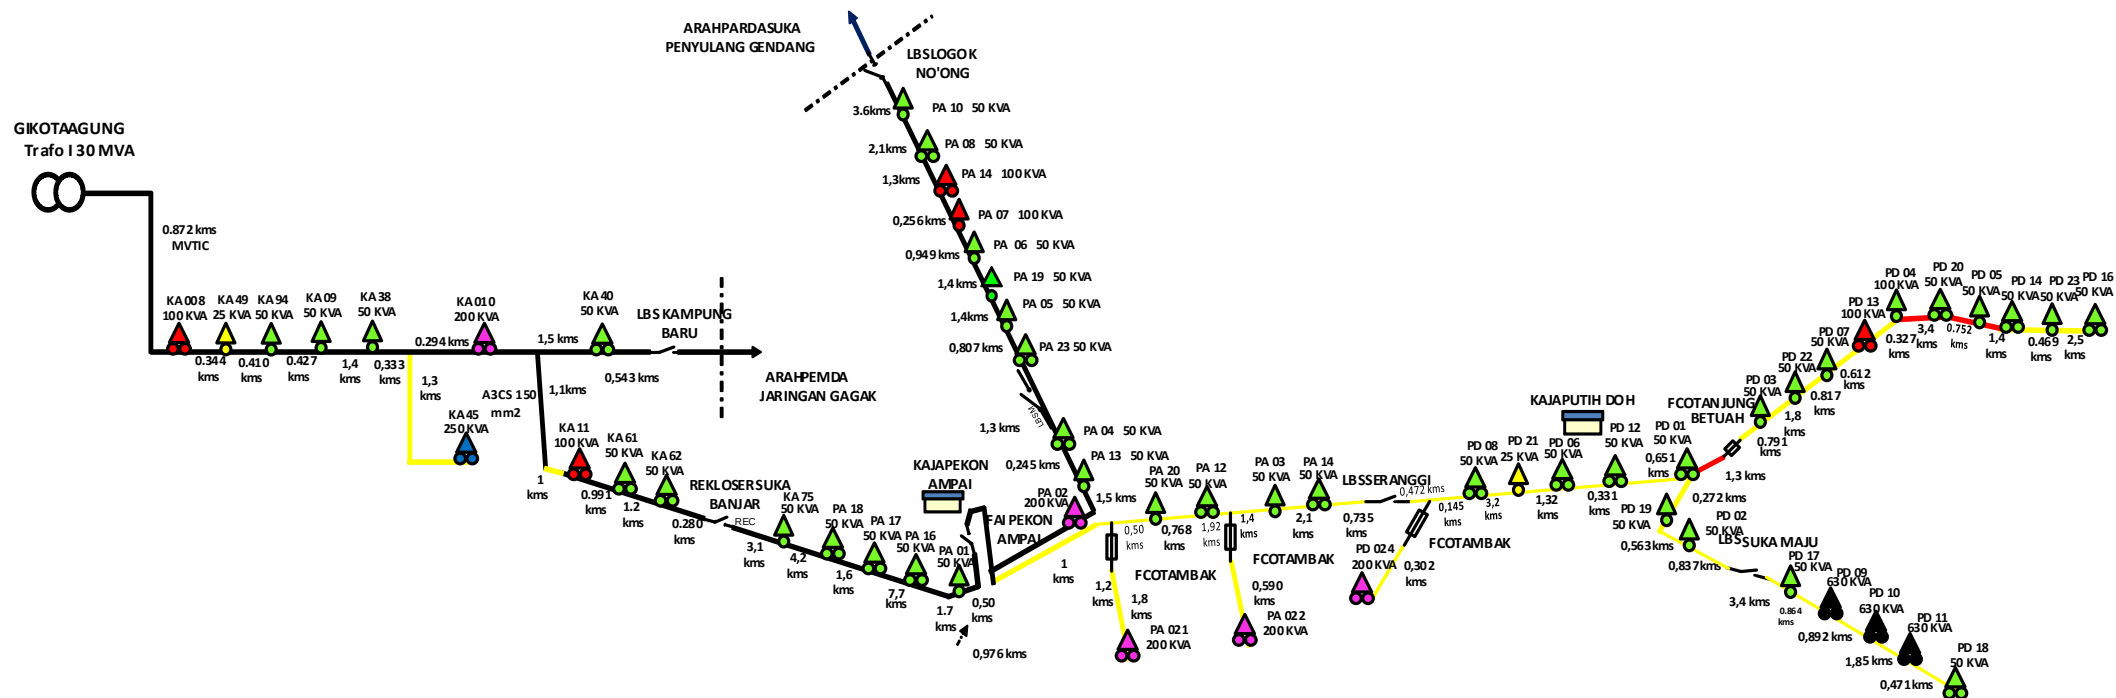

SINGLE LINE PENYULANG MURAY

PT PLN (PERSERO) AREA METRO
RAYON KOTA AGUNG

Skala :	Digambar	dd/mm/yy	Fulan
	Diperiksa	dd/mm/yy	Fulan
	Mengetahui	dd/mm/yy	Fulan
	Menyetujui	dd/mm/yy	Fulan