


TRANSFORMATOR DISTRIBUSI

◊LMK◊

JUMLAH FASE	3	JENIS TRAF0	HERMETIK
PERKURSI PENGENAL	50 Hz	NOMOR STANDAR	SPLN D3.002-1:2007
DAYA PENGENAL	400 kVA	NOMOR SERI	
TGANGAN PENGENAL PRIMER	20000 Volt		
TGANGAN PENGENAL SEKUNDER	400 Volt	TAHUN PEMBUATAN	
ARUS PENGENAL PRIMER	11.54 Amp	TIPE PENDINGINAN	ONAN
ARUS PENGENAL SEKUNDER	577.35 amp	KELOMPOK VEKTOR	Dyn5
TGANGAN IMPEDANS	4.0 %	TEMP. OIL/KOMP.	50 / 55 C
RUGI TANPA BEBAN-RUGI BEBBEBAN	595 W-3850 W	VOLUME MINYAK	313 liter
BAHAN BELTAN PRIMER-SEKUNDER	Cu-Cu	BERAT TOTAL	1860 kg
JENIS MINYAK	MINERAL	T . I . D	LI 125 AC 50/LI-AC 3

HV TAP VOLT	SW POS
21000	1
20500	2
20000	3
19500	4
19000	5

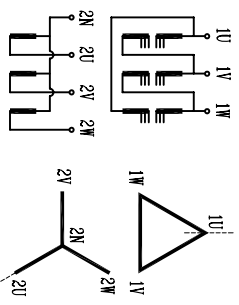

pt trafoindo prima perkasa

MATERIAL : GRAVOPLY 1.0 – 115 x 115 mm
LETTER, NUMBER, SYMBOL & LINE : BLACK (DEEP EDGE 0.2 mm)
BASE : WHITE, COLUMN – BLACK
WEATHERPROOF

MARKING AT DRAIN VALVE

TIDAK BOLEH DIBUKA DAN
UJI MINYAK TIDAK DIPERLUKAN

MARKING AT TAP CHANGER

PERUBAHAN POSISI SADAPAN
TANPA TEGANGAN

MATERIAL : STICKER 50 x 110 mm
BASE : GREY, COLUMN – BLACK
WEATHERPROOF

THIS DRAWING IS THE PROPERTY OF PT TRAF0INDO PRIMA PERKASA
IT MUST NOT BE REPRODUCED, UTILIZED, COMMUNICATED OR PUBLISHED WITHOUT EXPRESS PERMISSION

REV	ITEM	DATE	NAME	DATE	NAME	SCALE :
				DESIGNED 17-12-10	Ir. PIRDAUS	N.T.S
				DRAWN 17-12-10	M. S. KAHFI	
				CHECKED 17-12-10	Ir. M. RINJI	
				APPROVED		
				pt. trafoindo prima perkasa		
				NAME PLATE & MARKING		
				PROJ.		
				B-2311-Dj-K-14		
				H2-1		
				A4		
				Wo.No.:		